

# Post-combustion CO<sub>2</sub> Capture with Amino-Acid Salts

Ralph H. Weiland<sup>§</sup>, Nathan A. Hatcher & Jaime L. Nava  
Optimized Gas Treating, Inc.  
Clarita, OK 74535, USA

## ABSTRACT

Conventional amine-based solvents used for post-combustion CO<sub>2</sub> capture suffer from several common drawbacks. The most serious is the prohibitive energy consumed by solvent regeneration. Others include the additional process complexity needed to address solvent volatility, as well as dealing with oxidative and thermal degradation.

Salts of amino acids have been used for acid gas removal since the 1930s, mostly in Europe and especially in Germany for applications including refinery, natural gas and coke oven gas. These early solvents used the potassium salts of *N,N*-dimethylaminoacetic acid and *N*-methylalanine, the so-called ALKAZID<sup>®</sup> solvents developed by I. G. Farbenindustrie in the early 1930s.

Within the last five years, interest has developed in using the sodium or potassium salt of glycine (NaGly), the simplest primary amino acid, for CO<sub>2</sub> capture. Another proposal (Wagner et al., 2009) is to use the potassium salt of a tertiary amino acid such as dimethylglycine (KDiMGly), promoted with a conventional alkanolamine such as monoethanolamine (MEA). Sufficient kinetic and equilibrium data have been recently published to permit the detailed simulation of a CO<sub>2</sub> capture plant using sodium glycinate (NaGly). Public-domain data have been available for Alkazid DIK since at least 1979. NaGly and KDiMGly have recently been implemented within ProTreat<sup>™</sup>, a well-established mass transfer rate-based gas treating process simulator.

This paper benchmarks the performance of a conventionally configured 3,000 tonne/day CO<sub>2</sub> capture plant using NaGly, MEA-promoted KDiMGly and piperazine-promoted KDiMGly against the standard, 30 wt% MEA. Piperazine-promoted MDEA is also considered. The results are striking—the regeneration energy required with piperazine-promoted KDiMGly appears to be about 20% lower than for MEA in an identical plant. Furthermore, solvent rates are lower by about 20%. Combined with a neutralized amino acid's complete lack of volatility and its natural resistance to oxidation and thermal degradation, this finding puts caustic-neutralized amino acids into a class of solvents of potential commercial interest. The paper provides a detailed explanation of how and why a process based on NaGly or piperazine-promoted KDiMGly is likely to perform well.

---

<sup>§</sup> Corresponding author contact information: Mail: R. Weiland, Optimized Gas Treating, Inc., P.O. Box 125, Clarita, OK, 74535; Phone/fax: +1 580 428 3535; Email: rweiland@ogtrt.com

<sup>®</sup> ALKAZID is a registered trademark of BASF® SE

<sup>™</sup> ProTreat is a trademark of Optimized Gas Treating, Inc.

## INTRODUCTION

Post-combustion carbon capture is an applications area within gas treating with its own unique set of difficulties. Very few capture plants of any size have been built, so much of the discussion on carbon capture should correctly use the future tense. Huge gas volumes at essentially atmospheric pressure provide very little driving force for CO<sub>2</sub> absorption to take place so contactors will be of very large diameter, and filled with structured packing to minimize pressure drop associated with large gas volumes. Focus to date has been predominantly on thermally regenerable solvents, usually amine-based, although other technologies such as ionic liquids and enzyme solutions (carbonate anhydrases) are receiving serious attention.

The benchmark solvent is 30 wt% corrosion-inhibited MEA as originally developed by The Dow Chemical Company and currently licensed by Fluor under the name Econamine FG Plus<sup>SM</sup>. One of the drawbacks of conventional amines is their high volatility. The contactors in carbon capture are designed to be highly rich-end pinched. In other words, the plants are designed to operate at minimum reboiler duties and minimum circulation rates to keep energy consumption at the lowest possible level. The present obsession with lowering energy needs is quite understandable given that the energy required for an MEA-base carbon capture plant represents roughly one third of the plant's power generation capability. Energy consumption escalates dramatically as the CO<sub>2</sub> recovery requirement is increased. Thus, post-combustion carbon capture plants are intended only to remove the first 85% or so the CO<sub>2</sub> in the flue gas. Minimum circulation, minimum regeneration energy, and bulk CO<sub>2</sub> removal rich-end pinch the column and conspire to produce a large temperature bulge near the top of any well-designed contactor. The treated gas then will tend to be quite hot, making amine volatility losses very high. Thus, an amine with minimal vapour pressure is desired. Amino acids neutralized with an alkaline metal hydroxide are perfect candidates because they are indeed salts, and have zero vapour pressure.

Solvent regeneration consumes the overwhelming majority of the energy needed for CO<sub>2</sub> capture using thermally-regenerable solvents. A well-designed and optimised capture system for a 300 MW power plant will consume about 100 MW of the power plant output, most of it for solvent regeneration. Thus, anything that can be done to lower regeneration energy has a huge potential benefit to capture plant efficiency.

Another challenge peculiar to all post-combustion CO<sub>2</sub> capture plants is the unavoidable presence of oxygen caused by the use of excess combustion air in furnaces. Most amines react readily with oxygen and form a host of degradation products, some of which can lead to foaming and corrosion. Amino acids are naturally occurring materials that evolved to function very effectively in an oxygen-rich atmosphere and are quite resistant to oxidation. However, amino acids are almost pH neutral and their amino group is already protonated so they do not react with CO<sub>2</sub>. In the first part of this paper we discuss the amino acids and how they can be made reactive. In the second part comparisons are made between MEA, NaGly, MEA-promoted KDiMGly and piperazine-promoted KDiMGly. It is also pointed out why promoted MDEA is not a candidate for post-combustion carbon capture.

## BASE CASE — 3,500 MTPD CO<sub>2</sub> CAPTURE PLANT

To compare solvents readily on an equitable basis, a completely non-optimised plant for removing 85% of the CO<sub>2</sub> from a 300 MW station was selected as the basis. This amounts to the removal of about 3,000 tonnes/day (mtpd) of CO<sub>2</sub> from the combustion gas (at 85% removal efficiency). The raw gas was assumed to contain 13 mol% CO<sub>2</sub>, 86.8 mol% N<sub>2</sub> and 0.2 mol% O<sub>2</sub> at 70 mbar and 43 °C (110 °F). The absorber was simulated with 20 m of Mellapak M250.X structured packing and was sized for 50% of flood. Absorber pressure drop was generally about 20 mbar. The column bottom pressure was assumed to be 70 mbar. The regenerator was simulated with twenty 4-pass trays with feed to tray 3 from the top, and it was sized for 70% jet and downcomer flood.

Solvent compositions of amines were taken at the most commonly-used or conventional values, namely 30 wt% MEA, 45 wt% NaGly, 40 wt% KDiMGly, 45 wt% MDEA, and in the case of promoted amines, a 30:15 wt% mixture of KDiMGly:MEA and promotion with 5 wt% piperazine in the cases of KDiMGly and MDEA. Lean solvent temperature was set at 43 °C, the same as the raw gas, and a temperature approach of 5.5 °C (10 °F) was arbitrarily chosen for the cross exchanger.

Apart from the normal lean-rich cross exchanger, no attempt was made to heat integrate or in any way optimise plant configuration for any amine or blend. No doubt better results could be

obtained for any given solvent by paying attention to heat integration, optimizing temperature approaches in heat exchangers, more carefully selecting lean amine temperature, etc. so as to minimize OPEX and CAPEX. However, our objective was a simple comparison on a reasonably equitable basis between neutralized amino acids and MEA. Figure 1 shows the base flowsheet.


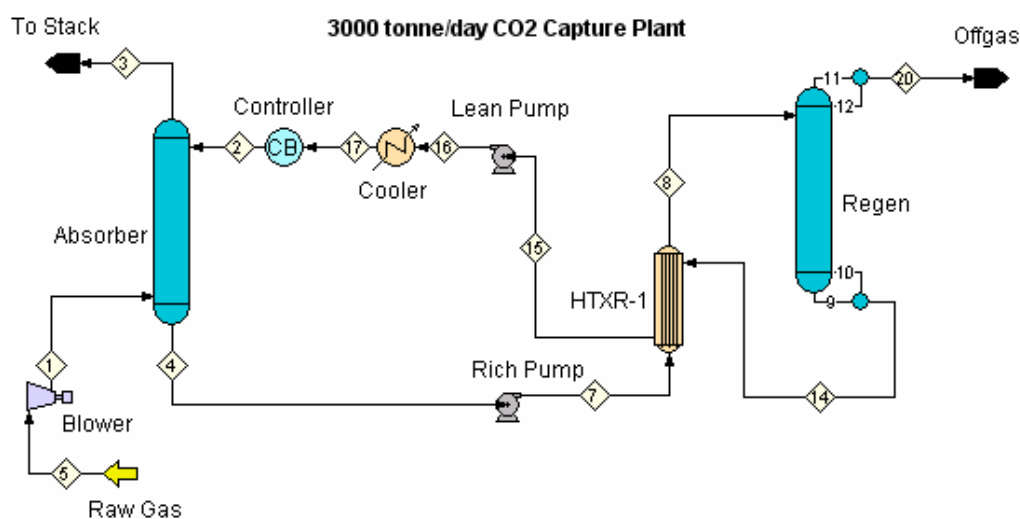


Figure 1 PFD of Rudimentary Carbon Capture Plant


## AMINO ACIDS AS CARBON CAPTURE SOLVENTS

Salts of amino acids appear first to have been used commercially for acid gas removal around 1935. The Alkazid® process developed by IG Farbenindustrie, and later formally by BASF AG after its reestablishment in 1952, uses the potassium salts of *N,N*-dimethylaminoacetic acid (also known as the potassium salt of dimethylglycinate) and *N*-methylalanine for treating refinery, coke-oven, and natural gases. It is noteworthy that refinery and especially coke-oven gases are two of the most severely aggressive treating services from contamination and solvent degradation standpoints. The process appears to have been most commonly applied in Europe, especially Germany, although there are instances of its use elsewhere.

Glycine, the simplest of the amino acids, will be used as a model for a generic amino acid. In water solution, it exists as a zwitter<sup>1</sup> ion




Because the amino group is protonated, it is completely nonreactive towards CO<sub>2</sub>. In fact, when heat stable salts are present in a treating solution, their acidic nature results in protonation of the amino group. When H<sub>2</sub>S is absorbed by an amine, again the amino group acts as a proton sink and it becomes protonated (and consumed) on a mole-for-mole basis. One of the ways in which heat-stable-salt-contaminated solvents can be (temporarily) recovered is by addition of caustic soda, being very careful not to add too much and create permanent lean loading. So, when the acid group is titrated (neutralized) with NaOH or KOH, the amino group deprotonates and the amine is returned to its reactive state. If the amine is an amino acid, its deprotonation converts the zwitterion into a fully active amine:



In the case of glycine, it produces what turns out to be a *highly-reactive primary* amine. With dimethyl glycine, the commercial product of neutralization (Alkazid DIK) is the potassium salt:

<sup>1</sup> The German word Zwitter means hybrid (hermaphrodite in biology)




Here, the amino group in potassium dimethyl glycinate (KDiMGly) is *tertiary*, and is therefore incapable of reacting directly with CO<sub>2</sub>, but it is perfectly capable of acting as a sink for the proton formed by CO<sub>2</sub> hydrolysis in water. The key then is the deprotonation of the inactive, protonated amino group in the amino acid zwitterion through its precise titration with caustic soda or caustic potash. The zwitterion can then release the fully-active amino group.

## COMPARING SOLVENTS

### Benchmark MEA

With the configuration of the plant, tower details, and combustion gas flow and composition completely fixed, once the solvent and its strength are selected there are really only two parameters that can be varied with appreciable effect on performance, namely, solvent circulation rate and reboiler duty. The benchmark is 30 wt% MEA. Figure 2 shows CO<sub>2</sub> recovery as a function of solvent circulation rate with reboiler duty (MW) as parameter.

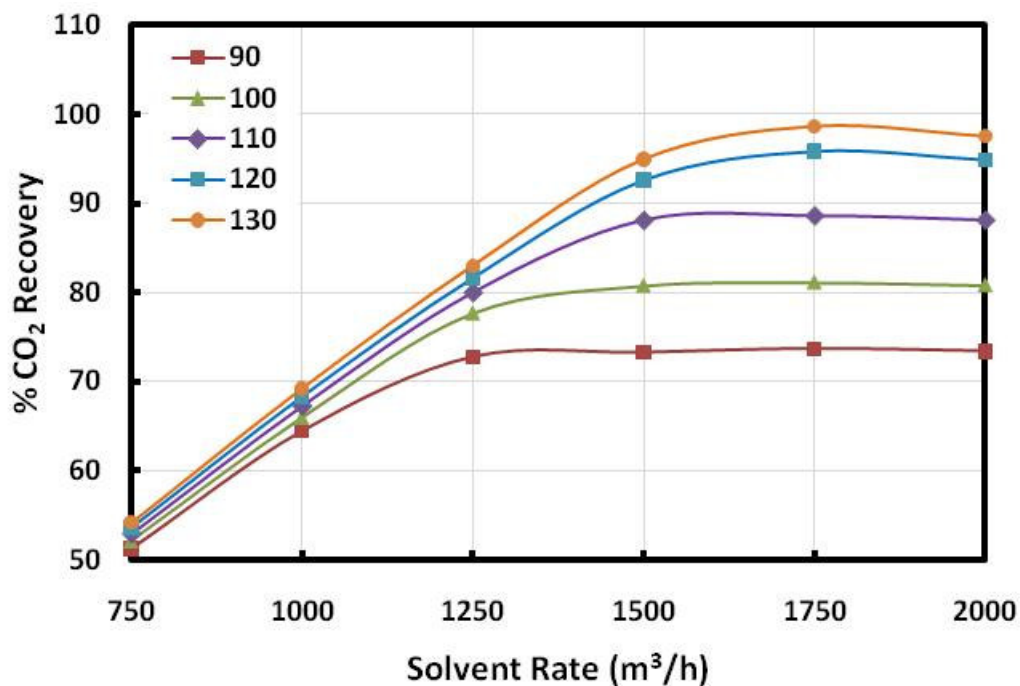

**Figure 2 Effect of solvent rate at various reboiler duties on CO<sub>2</sub> capture efficiency using MEA**

If the solvent rate is too low, no amount of reboiler duty will provide the solvent with enough capacity to absorb 85% of the CO<sub>2</sub> (the usual removal goal is 85%). But at around 1 500 m<sup>3</sup>/hr, a reboiler duty of about 105 MW appears to be needed to achieve the removal goal. This is close to the generally-accepted, but staggering one-third of plant power output. It is also interesting to note that higher removal efficiencies come at the cost of rapidly increasing energy demands. Further, as the circulation rate is increased beyond what is really required, no benefit accrues because the given reboiler duty is just sufficient to remove the given amount of CO<sub>2</sub>. If the circulation rate is increased to an extreme, of course, efficiency slowly drops off because the energy needed to take the rich feed from the temperature leaving the cross exchanger to the temperature on the feed tray slowly rises. In the vicinity of the minimum circulation rate needed to achieve the desired efficiency, higher rates provide no benefit, and lower rates slowly depress the efficiency.

### Sodium Glycinate

The data of Kumar et al. (2003) indicate that NaGly exhibits two to three *times* the reaction rate of MEA with CO<sub>2</sub>, depending on its concentration. Solubility data for CO<sub>2</sub> have been published recently by Song et al. (2007) and Harris et al. (2009); Lee et al. (2005) report physical property measurements, including pH data. The Deshmukh-Mather thermodynamic model used by ProTreat was regressed to the pH and VLE data while correlations were developed for such physical properties as density, viscosity and surface tension of the treating solutions. Figure 3 shows the dependence of recovery efficiency on circulation rate and reboiler duty and looks very similar to the MEA results of Figure 2. The required reboiler duty is almost identical to MEA, although 85% recovery can be achieved with only 1 250 m<sup>3</sup>/hr of solvent rather than the 1 500 m<sup>3</sup>/hr needed by MEA. The reason will become apparent later.

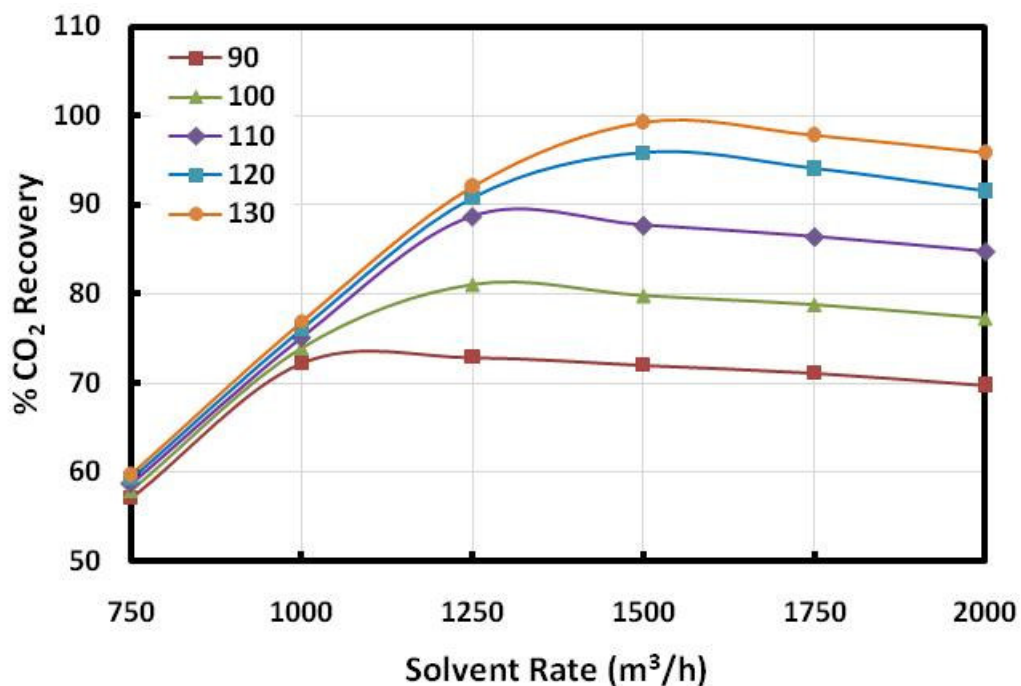


Figure 3 CO<sub>2</sub> capture efficiency using 45 wt% NaGly

## Potassium Dimethyl Glycinate

### MEA Promoter

KDiMGly has a tertiary amino group that is incapable of reacting with CO<sub>2</sub> to form carbamate. Lack of significant chemical reaction rate, therefore, suggests that CO<sub>2</sub> will experience significant difficulty getting into solution, although KDiMGly may still have very high capacity. Absorption must be promoted using a fast-reacting amine such as MEA or piperazine. Figure 4 shows simulated recoveries using 30 wt% KDiMGly promoted with 15 wt% MEA. Simulation of a variety of concentrations indicated that this particular combination most easily reached 85% CO<sub>2</sub> recovery with the least expenditure of energy. Nevertheless, the energy consumption using this mixture was simulated to be roughly 95 MW, only about 10% less than 30 wt% MEA. It appears from this figure that the replacement of a substantial fraction of high capacity ingredient (KDiMGly) with an equally-large fraction of fairly slowly reacting MEA, (which also has a half-mole-per-mole capacity limit for low CO<sub>2</sub> partial pressure gas), is not a very effective way to use the potentially higher capacity of KDiMGly.

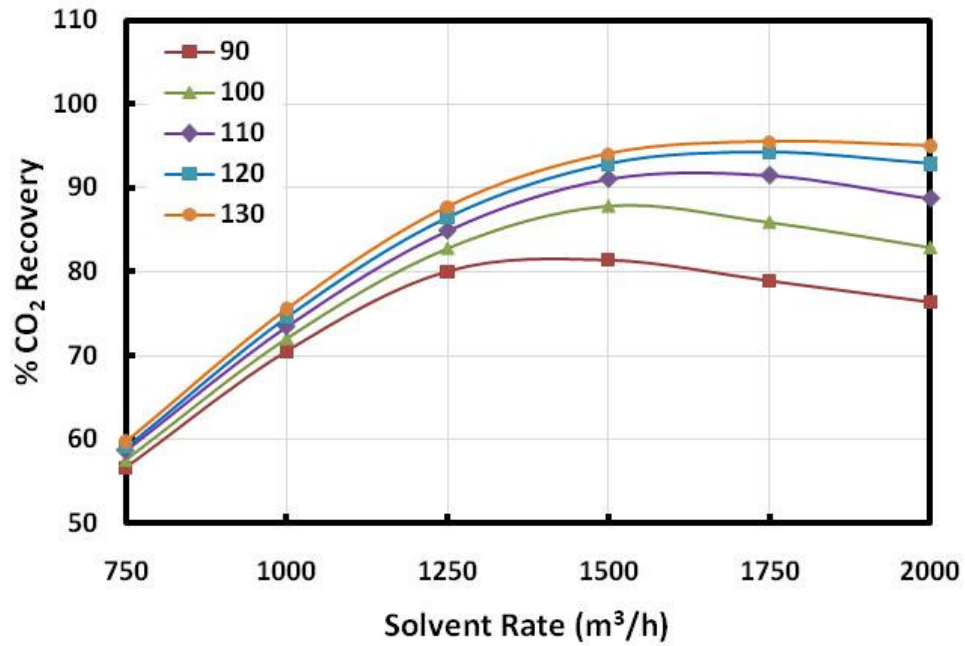


Figure 4 CO<sub>2</sub> capture efficiency using 30 wt% KDiMGly with 15 wt% MEA

**Piperazine Promoter**

The effect of using promoting 40 wt% KDiMGly 5 wt% piperazine is shown in Figure 5. It can be seen that 82 or 83 MW reboiler duty will easily allow

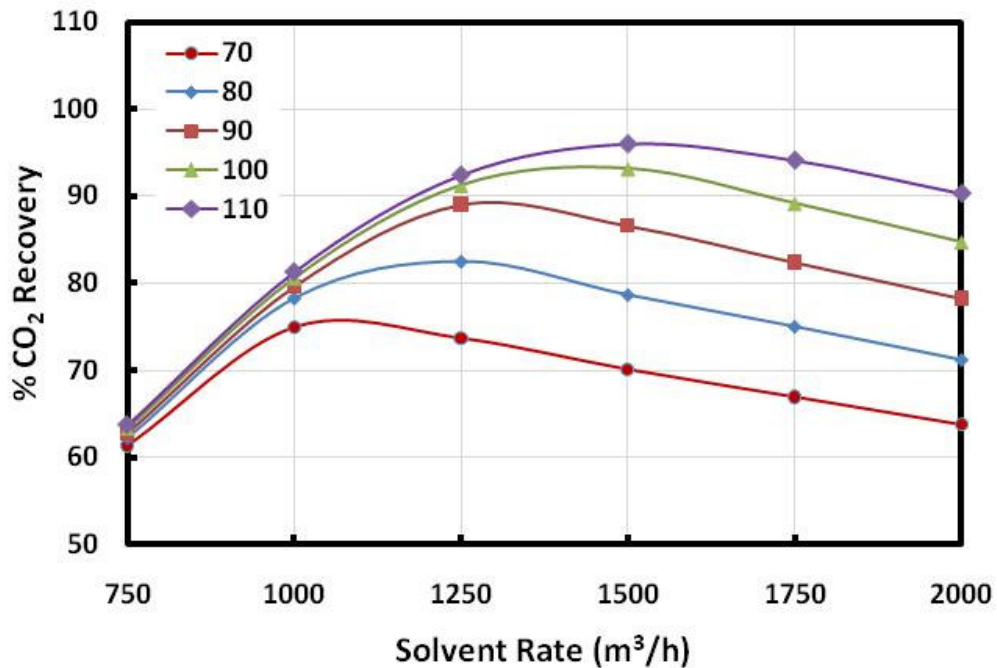



Figure 5 CO<sub>2</sub> capture efficiency using 40 wt% KDiMGly with 5 wt% piperazine

85% CO<sub>2</sub> recovery. This is roughly a 20% reduction over MEA with a lower solvent rate (1 250 m<sup>3</sup>/hr versus 1 500 m<sup>3</sup>/hr for MEA). When used as a promoter, 5 wt% piperazine is a typical concentration.

The purpose of the promoter (MEA or piperazine) is to enhance the rate of CO<sub>2</sub> absorption, not to alter the solvent's inherent capacity. Although the promoter will also alter the vapor liquid equilibrium (solvent capacity for CO<sub>2</sub>), the effect is relatively minor. Indeed, the tertiary amino acid already has a potentially much higher CO<sub>2</sub> capacity than MEA or NaGly, but the absorption rate is quite limited by the very slow kinetics of CO<sub>2</sub> hydrolysis. In other words, until the already-absorbed CO<sub>2</sub> can be hydrolysed, there is simply no room for any further absorption. Thus, making the CO<sub>2</sub> disappear rapidly via formation of an intermediate carbamate( which subsequently dissociates into carbonate and reforms the reactive amine) accelerates the absorption process without increasing the solvent capacity. Piperazine reacts with CO<sub>2</sub> nearly 10 times faster that MEA, so (i) much less of it is needed (it replaces less KDiMGly) and (ii) it enhances absorption rates many fold over MEA.

## MDEA

If KDiMGly is so effective for CO<sub>2</sub> capture, the question naturally arises as to whether MDEA promoted with piperazine might do just as well. Simulations were run for 45 wt% MDEA promoted with 5 wt% piperazine under similar conditions of circulation rate and reboiler duty already used for MEA and promoted KDiMGly. Figure 6 shows simulation results over a range of higher reboiler duties.

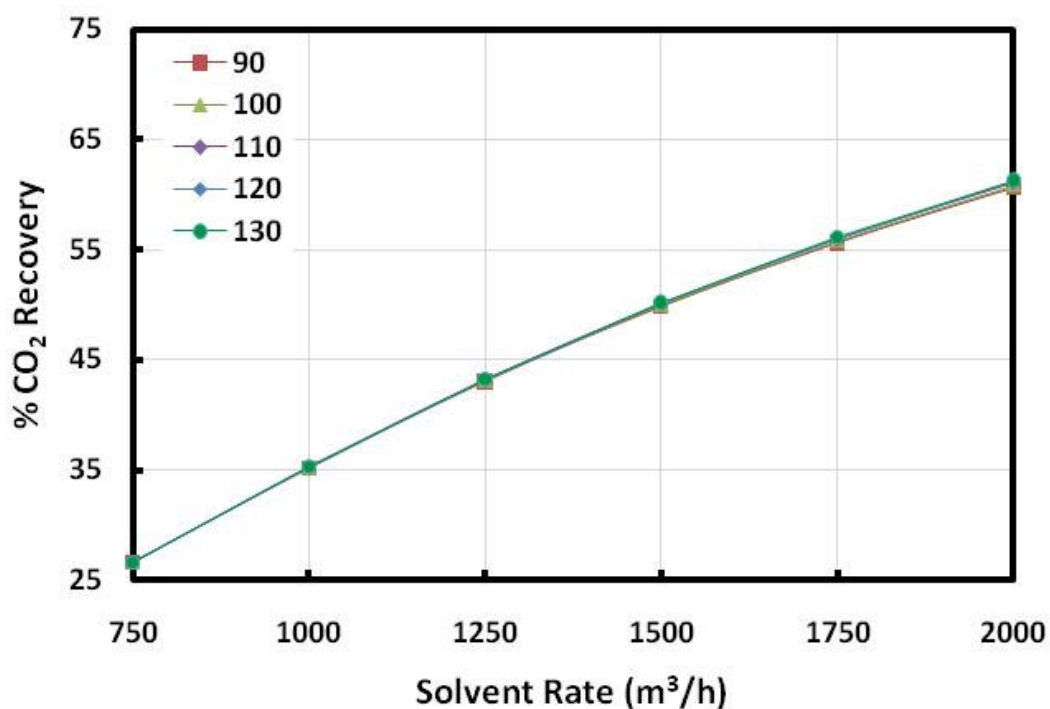

**Figure 5** CO<sub>2</sub> capture efficiency using 45 wt% MDEA with 5 wt% piperazine

At solvent rates typical of those used to this point, piperazine promoted MDEA appears incapable of reaching even 65% recovery, let alone the 85% desired. Indeed, at best this solvent has performance similar to grossly under circulated piperazine-promoted KDiMGly. The explanation must lay in the nature of MDEA versus KDiMGly vis à vis capacity and CO<sub>2</sub> equilibrium partial pressures.

## DISCUSSION OF SIMULATION RESULTS

There are several interesting questions raised by the simulation results, including:

- Why does NaGly require almost identical reboiler duty to MEA but can achieve the same recovery with 20% less solvent flow?
- What makes KDiMGly such an effective solvent when promoted with piperazine?
- Why is MDEA so ineffective in this application, even when promoted with piperazine?
- What are the relative roles played by vapour-liquid equilibrium, kinetics and heats of reaction and absorption? Put more bluntly, what are the characteristics of a good capture solvent?

Before starting to answer these questions, it is worth re-examining the unique aspects of carbon capture versus the more conventional treating of natural, refinery, and synthesis gases. In traditional gas treating, the target is almost always a gas that is relatively high purity with respect to at least one component. For example, natural gas transmission pipelines are restricted to conveying gas with only parts per million concentrations of H<sub>2</sub>S. Ammonia synthesis gas is limited to about 1,000 ppmv CO<sub>2</sub>. Such applications require a well-stripped solvent, and a well-stripped solvent requires considerable reboiler energy input. In carbon capture, on the other hand, the goal is bulk removal of CO<sub>2</sub> with about 15% of the original CO<sub>2</sub> left in the gas, and a truly lean solvent is not needed. Indeed, the required leanness of the solvent barely allows it to be referred to as “lean”, at least by traditional gas treating standards. In many situations only one or two stages of flash regeneration is needed. This means that reboiler duties can be turned right down and simultaneously the solvent run at absolutely minimum rates, just sufficient to meet an 80 or 85% removal goal. The key difference from conventional treating is that solvent lean loadings can be quite large because treating is limited by absorber rich-end conditions, not by a lean-end pinch created by seeking a high purity gas product.

The main concern in the contactor is ensuring absorption rates are high enough for treating to be done in a column of reasonable height. Height is controlled largely by reaction kinetics. The concern in the regenerator is producing a solvent just lean enough to have the requisite potential for holding the specified quantity of CO<sub>2</sub>. Obviously there is a balance to be struck between the solvent's flow rate and its loading potential such that reboiler energy is minimized.

So-called specialty amines or promoted solvents are all traditionally MDEA-based. The purpose of most (but not all) solvent additives is to provide higher reaction rates between the solvent components and CO<sub>2</sub>, which will enhance absorption rates into MDEA. It is easy to see from Table 1 why piperazine is such an effective promoter. It reacts with CO<sub>2</sub> nearly ten times faster than even MEA. Data in Table 1 are based on second-order kinetics at 25°C.

**Table 1 Reaction Rate Constants of Gas Treating Amines and Amino Acid Salts With CO<sub>2</sub>**

Amine	Reaction Rate Constant (L·mol <sup>-1</sup> s <sup>-1</sup> )
MEA <sup>P</sup>	6,000
DGA <sup>P</sup>	4,500
DEA <sup>S</sup>	1,300
DIPA <sup>S</sup>	100
Piperazine <sup>S</sup>	59,000
MMEA <sup>S</sup>	7,100
MDEA <sup>T</sup>	4
AMP <sup>P</sup>	600
NaGly <sup>P</sup>	8,000
KDiMGly <sup>T</sup>	~0

The value of the kinetic rate constant is unrelated to the primary or secondary nature of the amine (although it does appear from the literature to be related to the amine's pKa value). MDEA and KDiMGly are tertiary amines, they do not form carbamates, and they react with CO<sub>2</sub> hardly at all. The value 4 L·mol<sup>-1</sup>s<sup>-1</sup> for MDEA is indicative of the extent to which MDEA is purported to catalyse CO<sub>2</sub> hydrolysis. Because they are tertiary they do not strictly have the half-mole-per-mole stoichiometric



loading limit of the carbamate formers. But their lack of reactivity demands the use of promoters. Obviously, if one is to promote CO<sub>2</sub> absorption, piperazine is the chemical to use. Its drawback is a higher relative volatility than most other amines; however, a small water-wash section at the top of the absorber will recover most, if not all, vapourisation loss.

Table 2 shows representative values for the heats of absorption of CO<sub>2</sub> into a variety of amines and amino acid salts. These values are integral from 0 to 0.3 loading. The tertiary


**Table 2 Heats of Absorption of CO<sub>2</sub> into Various Amines and Amino Acid Salts at 25°C**

Amine	Heat of Absorption (kJ·gmol <sup>-1</sup> )
MEA <sup>P</sup>	84
DGA <sup>P</sup>	83
DEA <sup>S</sup>	76
DIPA <sup>S</sup>	73
Piperazine <sup>S</sup>	76
MMEA <sup>S</sup>	54
MDEA <sup>T</sup>	58
AMP <sup>P</sup>	85
NaGly <sup>P</sup>	85
KDiMGly <sup>T</sup>	55

amines have quite a bit small heats of absorption than the primary and secondary amines because there is no carbamation reaction. With the exception of MMEA, the heat of absorption appears to correlate with the primary, secondary or tertiary nature of the amine (indicated by a superscript appended to the amine's name in the tables).

MDEA and KDiMGly are both tertiary, neither reacts to any extent with CO<sub>2</sub>, and both have a low heat of absorption. One might expect some equivalence between them vis à vis their piperazine-promoted performance in CO<sub>2</sub> capture. Yet KDiMGly is very effective; whereas, MDEA is completely ineffective. A comparison of vapor-liquid equilibrium behavior between the various amines is revealing (Figure 6). The partial pressure of CO<sub>2</sub> over MDEA is on the order of 100 times higher than over KDiMGly at the same solution loading. For a 13% CO<sub>2</sub> combustion exhaust gas, 45% MDEA is completely saturated with CO<sub>2</sub> at a mole loading of only 0.3 (mol CO<sub>2</sub> per mole of MDEA). With 85% CO<sub>2</sub> recovery, the treated gas is about 2% CO<sub>2</sub> and the equilibrium loading in MDEA is 0.1 mol/mol. In a rich-end-pinch absorber, obviously MDEA is going to have to be stripped to a much lower lean loading than KDiMGly to accommodate the same loading increase. Deeper stripping requires more energy. To make matters worse, the loading capacity of MDEA even if 100% stripped is only 0.3 mol/mol, whereas, KDiMGly can easily absorb twice as much CO<sub>2</sub>; therefore, the circulation rate required for MDEA will be much higher than for KDiMGly and this will put a tremendous additional load on the regenerator. This can be clarified with an illustrative case.

For piperazine promoted 40 wt% KDiMGly at 1 250 m<sup>3</sup>/h and 90 MW reboiler energy, 89% of the CO<sub>2</sub> is recovered with the solvent loading going from 0.118 (lean) to 0.647 (rich), i.e., a loading increase of 0.529 mol/mol. For piperazine promoted 45% MDEA under otherwise identical conditions, the lean loading goes from 0.0034 (lean) to 0.231 (rich) with a total loading increase of only 0.228 mol/mol. Yes, MDEA can be stripped to much lower levels but this advantage is far outweighed by its much lower loading capacity at the rich end of the

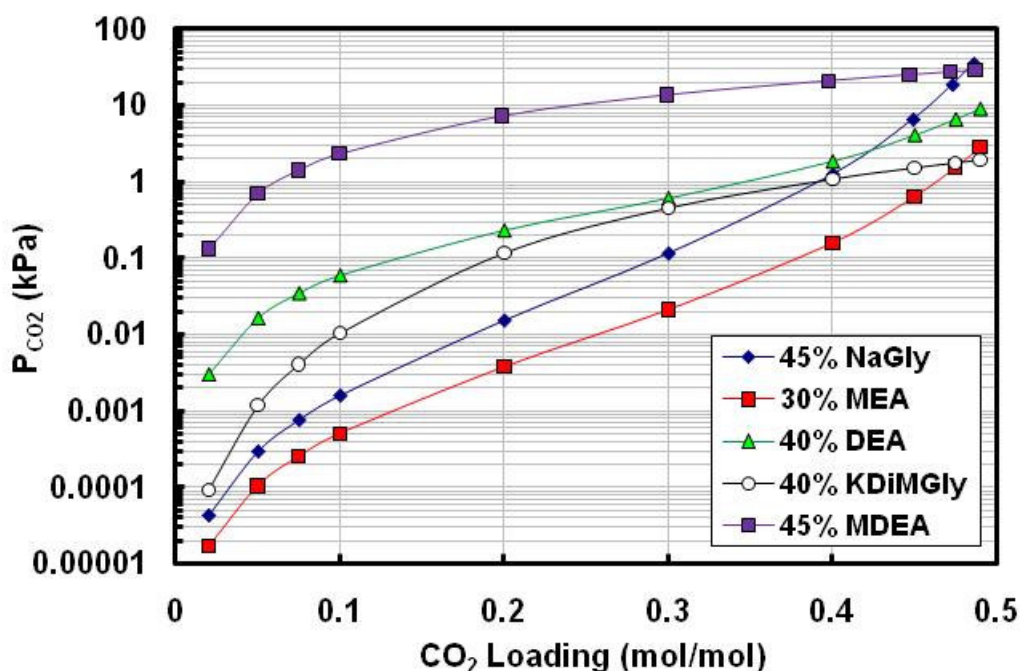

**Figure 6** Equilibrium partial pressures of CO<sub>2</sub> above various amine solutions at 35 °C

absorber where the equilibrium backpressure of CO<sub>2</sub> over the solvent is decisive. In fact, piperazine-activated MDEA certainly performs far worse than any other amine in this application.

It is also noted that MEA does not appear to be a particularly good promoter because too much has to be added to be effective, and this will probably require the displacement of a significant fraction of the lower-energy component, KDiMGly. The greatest benefit is had by maximizing the concentration of KDiMGly and using the minimum promoter possible. The caveat, however, is that KDiMGly becomes quite viscous at high concentrations and this will be detrimental to the absorption rate of CO<sub>2</sub> because of the effect of high liquid viscosity on the liquid-side coefficient for mass transfer.

### Other Considerations

Piperazine-promoted KDiMGly offers significant energy savings over MEA and MEA-promoted KDiMGly. But there are other advantages to amino-acid salts in general. The salts of amino acids are completely nonvolatile simply because they are salts. Of course, losses can occur by means other than vapourisation, such as entrainment from columns, and leaks and spills. Amino acids also tend to be quite resistant to oxygen—their natural habitat is an oxygen-containing environment. On the down side, they are known to be corrosive and to require stainless metallurgy.

### SUMMARY

Amino acid salts have been considered as post combustion CO<sub>2</sub> capture solvents and piperazine-promoted KDiMGly has been shown to have promise and significant advantages over MEA and certain other amines and blends. All of this has been done without direct experimentation, but rather on the basis of a solid, scientific, fundamental mass transfer rate model for columns, plus measurement of a few physico-chemical properties of the solvent chemicals involved.

The basic mass and heat transfer rate model itself has been tested extensively against actual plant performance data for many years, and it has been shown to be capable of true performance

*prediction*, frequently with uncanny accuracy. The fact that no adjustable parameters were used (such as efficiencies or residence times within tower internals) builds assurance that it really is predicting (rather than fitting) performance data. The fundamental soundness of the mass-transfer-rate approach is what allows the confident prediction of the performance of full-scale plants just from laboratory measurements of such things as vapour-liquid equilibrium, solvent pH, reaction kinetics, and solvent physical properties.

## LITERATURE CITED

Harris, F., K.A. Kurnia, M.I.A. Mutalib, M. Thanapalan, *Solubilities of Carbon Dioxide and Densities of Aqueous Sodium Glycinate Solutions before and after CO<sub>2</sub> Absorption*, J. Chem. Eng. Data, *54*, 144–147 (2009).

Kumar, P.S., J.A. Hogendoorn, G.F. Versteeg, P.H.M.Feron, *Kinetics of Reaction of CO<sub>2</sub> with Aqueous Potassium Salt of Taurine and Glycine*, AIChE Journal, *49*, 203–213 (2003).

Lee, S., S.-I. Choi, S. Maken, H.-J. Song, H.-C. Shin, J.-W. Park, K.-R. Jang, J.-H. Kim, *Physical Properties of Aqueous Sodium Glycinate Solution as an Absorbent for Carbon Dioxide Removal*, J. Chem. Eng. Data, *50*, 1773–1776 (2005).

Song, H.-J., S. Lee, S. Maken, J.-J. Park, J.-W. Park, *Solubilities of Carbon Dioxide in Aqueous Solutions of Sodium Glycinate*, Fluid Phase equilibria, *246*, 1–5 (2006).

Wagner, R., Lichtfers, U., Schuda, V., *Removal of Carbon Dioxide from Combustion Exhaust Gases*, U.S. Patent Application, US 2009/0320682 A1, Dec 31, 2009